


## 優良住宅部品認定基準による給水量早見表

給水量の決め方

優良住宅部品認定基準による方法

- 10戸未満 : Q=42N
- 10戸～600戸未満 : Q=19N
- 600戸以上 : Q=2.8N

Q:瞬間最大水量(L/分)  
 N:戸数  
 1人1日平均使用水量:250L  
 1戸当りの平均人数:4人

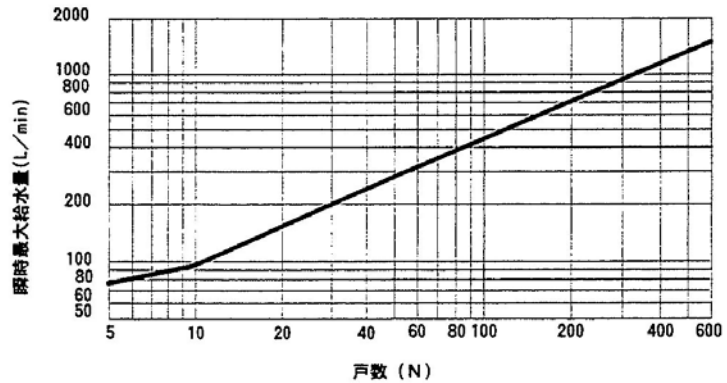

瞬時最大給水量

給水戸数(戸)	0	1	2	3	4	5	6	7	8	9
0	0.0	42.0	52.8	60.4	66.4	71.5	75.9	79.9	83.5	86.8
10	88.9	94.8	100.5	106.0	111.4	116.7	121.8	126.9	131.8	135.7
20	141.4	146.1	150.8	155.3	159.8	164.2	168.6	172.9	177.2	181.4
30	185.6	189.7	193.8	197.8	201.8	205.8	209.7	213.6	217.4	221.2
40	225.0	228.8	232.5	236.2	239.9	243.5	247.1	250.7	254.3	257.8
50	261.3	264.8	268.3	271.7	275.1	278.5	281.9	285.3	288.6	291.9
60	295.2	298.5	301.8	305.1	308.3	311.5	314.7	317.9	321.1	324.2
70	327.4	330.5	333.6	336.7	339.8	342.8	345.9	348.9	352.0	355.0
80	358.0	361.0	364.0	366.9	369.9	372.8	375.8	378.7	381.6	384.5
90	387.4	390.3	393.1	396.0	398.8	401.7	404.5	407.3	410.1	412.9
100	415.7	418.5	421.3	424.0	426.8	429.5	432.3	435.0	437.7	440.4
110	443.1	445.8	448.5	451.2	453.9	456.5	459.2	461.8	464.5	467.1
120	469.7	472.3	475.0	477.6	480.2	482.8	485.3	487.9	490.5	493.0
130	495.6	498.2	500.7	503.2	505.8	508.3	510.8	513.3	515.8	518.3
140	520.8	523.3	525.8	528.3	530.8	533.2	535.7	538.1	540.6	543.0
150	545.5	547.9	550.3	552.8	555.2	557.6	560.0	562.4	564.8	567.2
160	569.6	572.0	574.3	576.7	579.1	581.4	583.8	586.1	588.5	590.8
170	593.2	595.5	597.8	600.2	602.5	604.8	607.1	609.4	611.7	614.0
180	616.3	618.6	620.9	623.2	625.5	627.8	630.0	632.3	634.6	636.8
190	639.1	641.3	643.6	645.8	648.1	650.3	652.5	654.8	657.0	659.2
200	661.4	663.6	665.8	668.0	670.2	672.4	674.6	676.8	679.0	681.2
210	683.4	685.6	687.7	689.9	692.1	694.2	696.4	698.6	700.7	702.9
220	705.0	707.2	709.3	711.5	713.6	715.7	717.8	720.0	722.1	724.2
230	726.3	728.5	730.6	732.7	734.8	736.9	739.0	741.1	743.2	745.3
240	747.3	749.4	751.5	753.6	755.7	757.7	759.8	761.9	763.9	766.0
250	768.1	770.1	772.2	774.2	776.3	778.3	780.4	782.4	784.4	786.5
260	788.5	790.5	792.6	794.6	796.6	798.6	800.7	802.7	804.7	806.7
270	808.7	810.7	812.7	814.7	816.7	818.7	820.7	822.7	824.7	826.7
280	828.7	830.6	832.6	834.6	836.6	838.5	840.5	842.5	844.4	846.4
290	848.4	850.3	852.3	854.2	856.2	858.1	860.1	862.0	864.0	865.9
300	867.9	869.8	871.7	873.7	875.6	877.5	879.4	881.4	883.3	885.2

表の見方  
 給水戸数30戸の : 縦30 横0 の欄 → 185.6 L/Min  
 給水戸数45戸の : 縦40 横5 の欄 → 243.5 L/Min  
 (給水量は、小数点第2位を切り上げ)

(有)山中設備企画室:opへ